

**ATTAR TEST REPORT NUMBER: 15/9094.3**

The results of the tests, calibrations and/or measurements included in this document are traceable to Australian/national standards.
Accredited for compliance with ISO/IEC 17025.
Accreditation Number: 2735

26 June 2015

Total Pages: 2**WET PENDULUM SLIP RESISTANCE**

Job No: M15/9094

Prepared for:	QEP Australia Pty Ltd PO Box 1225 DANDENONG, VIC 3175					
Attention:	Ugo Tettamanti					
Test Site:	ATTAR, Unit 1, 64 Bridge Road, Keysborough.					
Test Date:	25 June 2015					
Test Specimens, Size & Quantity:	Roberts Stair nosing with carborundum insert, items 48-2805-B 48-2806-B 48-2807-B, mounted to particle board, board size 600x300 mm, 1 off supplied.					
Sampling & Direction of Testing:	Sampling conducted by client. Testing conducted at 10° offset to the direction of pedestrian movement on stair descent. Refer to Figure 1.					
Test Personnel:	Gerard Millar					
Preparation:	Washed with water and pH neutral detergent, rinsed with water, then dried.					
Fixed/Unfixed:	Unfixed.					
Air Temperature:	23°C					
Test Equipment:	Munro Stanley Skid Resistance Tester (Pendulum) Serial Number 0320, Calibrated 16/10/2013.					
Test Standard:	AS 4586: 2013 Slip resistance classification of new pedestrian surface materials – Appendix A.					
Slider Rubber:	Slider 55 Batch No. #83 prepared on P400 & 3µm lapping film.					
Classification Criteria:	Refer to Classification Criteria, attached as Appendix 1.					
British Pendulum Number	Specimen Number					SRV
	1	2	3	4	5	
	67	63	68	64	69	66
Classification:	P5					

These results apply only to the specimens tested and it is recommended that before selection of flooring or paving materials the effect of service conditions, including maintenance procedures and wear on their slip-resistance be checked.

NOTE: Any specimens supplied will be disposed of in two (2) months time, unless otherwise instructed.

ATTAR

Christopher Peake BEng (mech) Hons.,
Mechanical and Testing Engineer
Approved Signatory

This report may not be reproduced except in its entirety.

Page 1 of 2

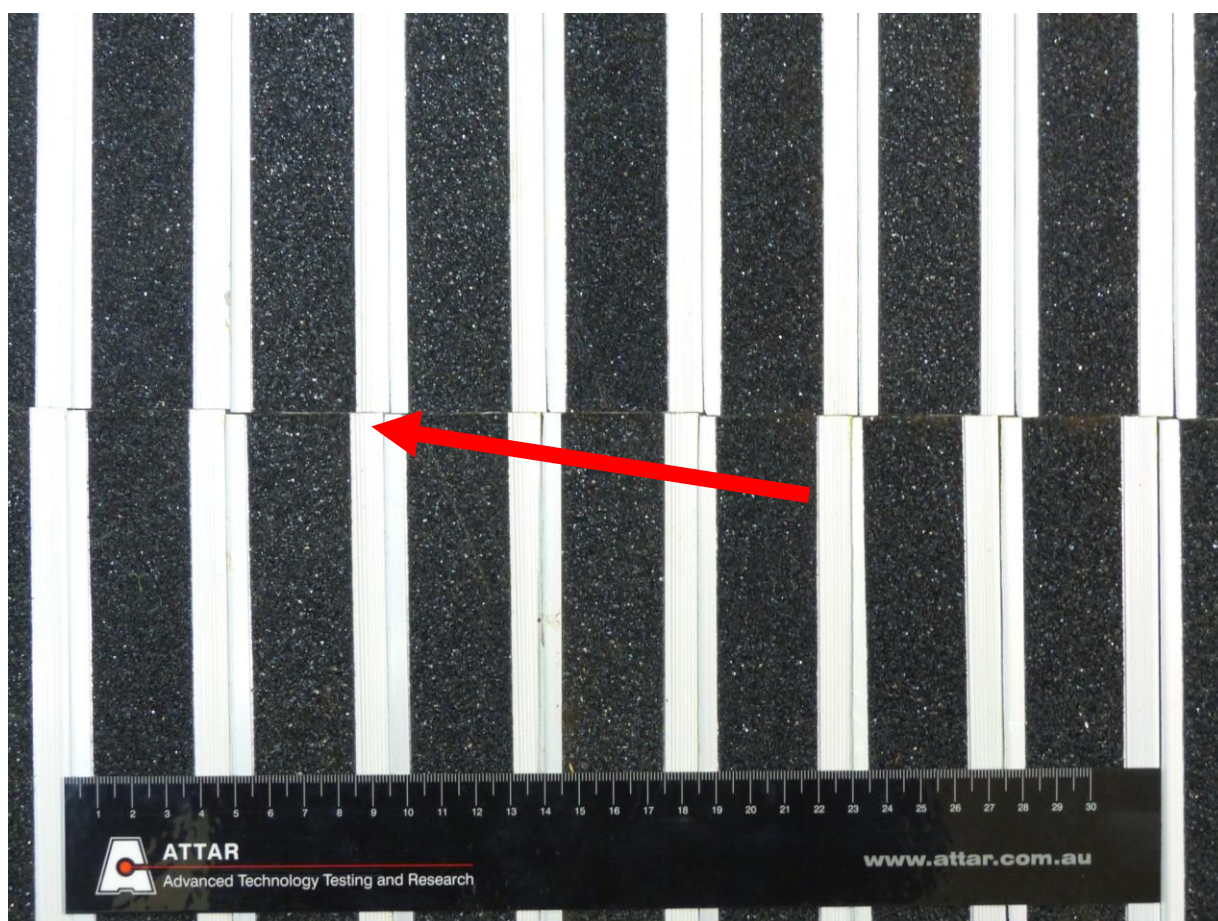


Figure 1: Roberts Stair nosing with carborundum insert, items 48-2805-B 48-2806-B 48-2807-B, mounted to particle board. Arrow indicates direction of testing.